**DOI: https://doi.org/10.15276/hait.05.2022.23**
**UDC 004.662.99·519.6**

# Control of a thermoelectric cooling unit complex mixed electrical connection in an uneven temperature field

**Vladimir P. Zaykov[1)]**
ORCID: http://orcid.org/0000-0002-4078-3519; gradan@i.u. Scopus Author ID: 57192640250
**Vladimir I. Mescheryakov[2)]**
ORCID: http://orcid.org/0000–0003–0499–827X; gradan@ua.fm. Scopus Author ID: 57192640885
**Yurii I. Zhuravlov[3)]**
ORCID: http://orcid.org/0000-0001-7342-1031; ivanovich1zh@gmail.com. Scopus Author ID: 57190425471
[1)] Research Institute "STORM", 27, Tereshkova Str. Odessa, 65076, Ukraine
[2)] State Environmental University, 15, Lvivska Str. Odessa, 65026, Ukraine
[3)] National University "Odessa Maritime Academy", 8, Didrikhson Str. Odessa, 65029, Ukraine

## ABSTRACT

A possibility of optimal thermal management of a number of temperature-dependent and heat-laden elements of radio electronic equipment with different power dissipation in an uneven temperature field using a set of thermoelectric cooling devices with mixed electrical connection and fixed geometry of thermocouple branches has been considered. Ratios for determining the relative operating current corresponding to the minimum supply voltage at a given thermal load for different temperature gradients and thermocouple branch geometries are derived. The possibility of selecting a supply voltage for a group of thermoelectric coolers with parallel electric connection using both analytical and graphical methods of solving a system of algebraic equations of first and second orders is shown. The basic parameters, reliability indices and dynamic characteristics of a thermoelectric cooler complex with mixed electrical connection when a group of thermoelectric coolers with series electrical connection operates at maximum cooling capacity and supply voltage variation of a group of coolers with parallel electrical connection are evaluated. Analysis of the research results showed the possibility of selecting the optimum supply voltage for a group of thermoelectric coolers with parallel electric connection in the interrelation of energy, mass-dimensional and dynamic characteristics, taking into account the reliability indicators of the complex as a whole. It is shown that by reducing the supply voltage of a group of thermoelectric coolers with parallel electric connection included in the complex, the energy, mass-size and dynamic characteristics are improved, and the reliability of the complex with mixed electric connection in an uneven temperature field is increased.

**Keywords:** Thermoelectric cooler; thermal mode; connection models; supply voltage; reliability performance; dynamic performance

***For citation*: Zaykov V. P., Mescheryakov V. I., Zhuravlov Yu. I. "Control of a thermoelectric cooling unit complex mixed electrical connection in an uneven temperature field". *Herald of Advanced Information Technology*. 2022; Vol. 5 No. 4: 309–324. DOI: https://doi.org/10.15276/hait.05.2022.23**

## INTRODUCTION

One of the most acceptable ways of providing thermal modes and components of radio electronic equipment is thermoelectric, as the most effective in a wide range of operating temperatures from 140K to 350K. Thermoelectric cooling devices (TEC) allow controlling heat flow by simply changing the operating current value. The main advantages of thermoelectric cooling are the high reliability and small overall dimensions of the TEC, the ease of control and the speed of operation. These advantages inherently result from the solid-state nature of these coolers.

© Zaykov V., Mescheryakov V., Zhuravlov Yu., 2022

The design features of radio-electronic equipment include a dispersed arrangement of heat-loaded elements with different power dissipation. Therefore, in order to provide a given thermal mode of a number of heat-loaded and heat-dependent elements of radio electronic equipment, a group system of TEC layout with mixed electrical connection, located on one heat sink can be used. In this case, for a group of TEC connected electrically in parallel, different supply voltages can be used, finding the optimal ones taking into account a number of limiting factors for mass-size, power, dynamic and reliability characteristics.

For a group of TECs connected electrically in series, we select the current operating mode $Q_{0\max}$,

This is an open access article under the CC BY license (http://creativecommons.org/licenses/by/4.0/deed.uk)

and consequently, the value of the operating current for the mixed electrical connection: at different cooling level $T_0$, the value of thermal load $Q_0$, at the geometry of the thermocouple branches $l/S$ =4.5, which is the subject of this paper.

## LITERARY REVIEW

The generation of heat is an integral part of the operation of electronic equipment, facilitated by transients when components are in active mode. This leads to the need to dissipate excess heat - thermal management systems, as the reliability of operation is directly dependent on the temperature [1]. Thermoelectric thermal management systems are superior to all other types of coolers in terms of their mass-size, climatic and mechanical characteristics [2, 3]. However, the requirements for modern thermally loaded elements are increasing rapidly [4, 5], which leads to the need to improve the dynamic performance and reliability of thermal mode systems. According to thermal model the heat loaded element and its thermal mode support system are included in series, which leads to necessity of increasing its dynamic characteristics and reliability indexes [6, 7]. The study of influence of thermal load of fuel injection equipment on reliability indicators is devoted to work [8], however, the influence of design parameters was not considered in it. In [9] the results of analysis on reliability indices, and in [10] the current modes of operation are presented, which allowed to propose optimal conditions of TDP operation. The inclusion of TEC in the control loop extends the intellectual capabilities of thermal mode support systems, but the dynamic characteristics important for control have not even been considered [11]. The importance of this problem in relation to reliability in thermal devices is that as switching frequency increases, reliability performance decreases [12]. The difference in the linear temperature expansions of the substrate material and thermocouple branches leads to junction cracking [13]. The importance of the task of including TEC in the control circuit has led to a series of works related to the study of the relationship of dynamic characteristics and reliability indicators with the design [14], the number of thermocouples [15], current operating modes [16]. In works [17, 18] possibilities of optimization of reliability and dynamics indices of fuel injection equipment by complex criteria including these indices are substantiated. At the same time, the conducted researches concern the use of single TEC for thermal mode support systems. The task of controlling the thermal mode support system of several TECs for distributed heat-loaded elements in an uneven temperature field remains relevant.

## PURPOSE AND OBJECTIVES OF THE RESEARCH

The aim of the work is to improve the quality of thermal management of a set of thermoelectric cooling devices with mixed electrical connection in an uneven temperature field.

To achieve this goal it is necessary to solve the following tasks:

1. To develop a mathematical model of thermoelectric system of thermal modes provision with regard for reliability indicators and functioning dynamics.

2. To analyze developed model to identify optimal characteristics of thermoelectric cooler model.

## DEVELOPMENT OF A MODEL OF THE THERMOELECTRIC DEVICE COMPLEX

To solve the first problem, we will use the known relations [19].

The number of thermoelectric elements $n$ in TEC for a given heat load $Q_0$ and temperature drop $\Delta T$ can be determined from the relation:

$$n = \frac{Q_0}{I_{\max}^2 R(2B - B^2 - \Theta)}. \qquad (1)$$

where $Q_0$ is the heat load value, W, or dissipation power of the cooling object; $I_{\max} = \frac{e\bar{T}_0}{R}$ is maximum operating current, A; $\bar{e}$ is the averaged value of coefficient of thermoelectric EMF of the thermocouple branch at the end of the cooling process, V/K; $T_0$ – is temperature of heat-absorbing junction, K; $R = \frac{l}{\bar{\sigma} S}$ is electrical resistance of the thermocouple branch at the end of the cooling process, Ohm; $l$ and $S$ are, respectively, height and cross-sectional area of the thermocouple branch; $\bar{\sigma}$ – is average conductivity value of the thermocouple branch, Sm/cm; $B_K = I/I_{\max K}$ is relative operating current at the end of the cooling process; $I$ is value of operating current, A; $\Theta = \frac{T - T_0}{\Delta T_{\max}}$ is


ISSN 2663-0176 (Print)
ISSN 2663-7731 (Online)

the relative temperature difference; is temperature of the fuel junction, K; $\Delta T_{\max} = 0{,}5\bar{z}T_0^2$ is maximum temperature difference, K; $\bar{z}$ is average value of thermoelectric raw materials in the module, 1/K.

The power consumption $W$ of the TEU can be represented as:

$$W = 2nI_{\max}^2 RB\left(B + \frac{\Delta T_{\max}}{T_0}\Theta\right). \quad (2)$$

Voltage drop $U_K$:

$$U_K = \frac{W_K}{I}. \quad (3)$$

The cooling factor $E$ can be calculated from the expression:

$$E = \frac{Q_0}{W_K}. \quad (4)$$

The relative failure rate of a single stage TEC $\lambda/\lambda_0$ can be determined from the expression [19]:

$$\frac{\lambda}{\lambda_0} = nB_K^2(\Theta + c)\frac{\left(B_K + \frac{\Delta T_{\max}}{T_0}\Theta\right)^2}{\left(1 + \frac{\Delta T_{\max}}{T_0}\Theta\right)^2}K_T, \quad (5)$$

where $c = \frac{Q_0}{nI_{\max}^2 R}$ is the relative heat load; $K_T$ is reduced temperature coefficient [19]; $\lambda_0 = 3\cdot 10^{-8}$ is nominal failure rate, 1/hour.

The probability of no-failure operation $P$ of the TEC can be determined from the expression:

$$P = \exp(-\lambda t), \quad (6)$$

where $t$ is the designed lifetime, h.

The expression for the time of reaching the steady-state operation $\tau$ mode can be represented as [20]:

$$\tau = \frac{m_0c_0 + \sum_i m_i c_i}{K\left(1 + 2B_K\frac{\Delta T_{\max}}{T_0}\right)}\ln\frac{\gamma B_H(2 - B_H)}{2B_K - B_K^2 - \Theta}, \quad (7)$$

where $m_0c_0$ is the product of mass and heat capacity of the cooling object $\to 0$:

$\sum_i m_i c_i$ is the total value of products of heat capacity and mass of structural and technological elements at heat-absorbing junction of the module at given geometry of thermocouple branches (relations $l/S$);

$$\gamma = \frac{I_{\max H}^2 R_H}{I_{\max K}^2 R_K};$$

$R_H$ is the electrical resistance of the thermocouple branch at the beginning of the cooling process, Ohm;

$B_H = \frac{I}{I_{\max H}}$ is relative operating current at the beginning of the cooling process at $\tau$ =0;

$I_{\max H} = \frac{e_H\bar{T}}{R_H}$ is the maximum operating current at the start of the cooling process, A.

Assuming equal currents at the start and end of the cooling process:

$$I = B_K I_{\max K} = B_H I_{\max H}. \quad (8)$$

Block diagram of the complex with mixed electrical connection of TEC is shown in Fig. 1.

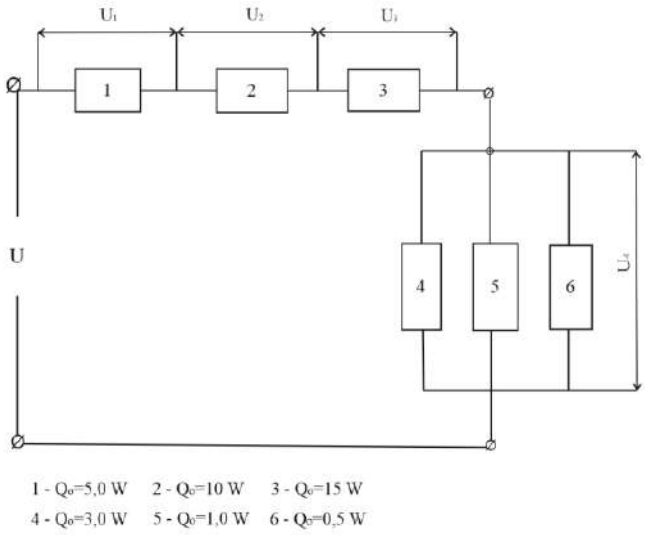



*Fig. 1.* **Connection diagram of thermoelectric coolers:**
**1 – $Q_0$ =5W; 2 – $Q_0$ =10W; 3 – $Q_0$ = 15W;**
**4 – $Q_0$ =3W; 5 – $Q_0$ =10W; 6 – $Q_0$ =0,5W**
***Source:*** **compiled by the authors**

In the following, we will consider the mixed electrical connection of the TECs in a complex consisting of six TECs, three of which are connected electrically in series with a thermal load $Q_0$=15W, 10W, 5W, with a corresponding cooling temperature level $T_0$=295K, $T_0$=290K, $T_0$=280K. The remaining three are connected in parallel in a common circuit with a typical load $Q_0$=3.0W, 1.0W, 0.5W at the corresponding temperature cooling level $T_0$=270K, $T_0$=160K, $T_0$=250K at fixed thermocouple geometry (ratio $l/S$=4.5).

The results of calculations of the basic parameters, reliability indicators and dynamic characteristics of a group of TEC with series electrical connection, one of which operates in the mode of $Q_{0\max}$, are given in Table 1.

Consider a group of TEC units consisting of three chillers that are part of a complex, connected electrically in parallel and operating in an uneven temperature field and with different thermal load $Q_0$. For this purpose, we will determine the minimum voltage value.

Using relations (1) and (3), it is possible to write down the expression for the supply voltage $U$ of the TEC depending on the relative operating current $B$ for a given temperature drop $\Delta T$ and the thermal load value $Q_0$:

$$U = \frac{2Q_0\left((B + \frac{\Delta T_{\max}}{T_0}\Theta\right)}{I_{\max}\left(2B - B^2 - \Theta\right)}, \qquad (9)$$

either as a criterion

$$K = \frac{UI_{\max}}{2Q_0} = \frac{\left(B + \frac{\Delta T_{\max}}{T_0}\Theta\right)}{(2B - B^2 - \Theta)}, \qquad (10)$$

which makes it possible to determine the optimum relative operating current $B_{opt}$ corresponding to the minimum of the criterion $K$, or the supply voltage $U_{\min}$ at a given thermal load $Q_0$ for different temperature drops $\Delta T$ and the geometry of the thermocouple branches (ratio $l/S$).

Fig. 2 shows the dependence of TEC group value $K = \frac{UI_{\max}}{2Q_0}$ on the relative operating current $B$ for different relative temperature drops $\Theta$.

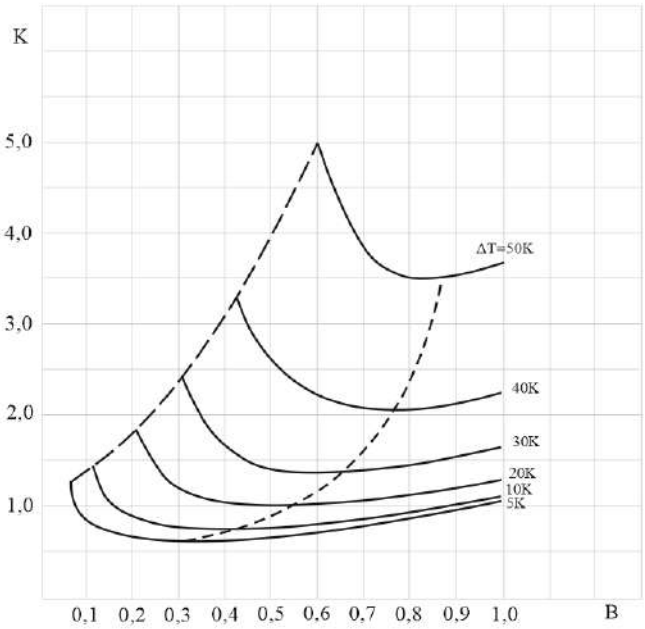



*Fig. 2.* **Dependence $K = \frac{UI_{\max}}{2Q_0}$ of TEC value and relative operating current $B$ for different temperature differences $\Delta T$ at $T = 300K, l/S = 4{,}5$. The dotted line represents the geometric location of the points corresponding to the minimum of $K_{opt}$**

***Source:*** **compiled by the authors**

*Table 1.* **Calculation results for the main parameters when connecting the TEC in series** $(T = 300\,K, l/S = 4{,}5, I_0 = 11.7A, T - T_c = 5K)$

| $T_0$, $K$ | $Q_0$, $W$ | B | $\Theta$ | $n$, $pcs$ | $W$, $W$ | $U$, $V$ | E | $\tau$ | $N$, $W \cdot s$ | $\alpha F$, $W/K$ | $\lambda/\lambda_0$ | $\lambda \cdot 10^8$, $1/h$ | $P$ |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 280 | 5.0 | 1.0 | 0.213 | 9.7 | 13.6 | 1.16 | 0.37 | 2.7 | 36.3 | 3.7 | 9.8 | 29.4 | 0.9971 |
| 290 | 10.0 | 0.975 | 0.10 | 15.8 | 21.9 | 1.87 | 0.457 | 1.2 | 26.0 | 6.4 | 14.4 | 43.2 | 0.9957 |
| 295 | 15.0 | 0.967 | 0.848 | 21.9 | 30/2 | 2.58 | 0.50 | 0.6 | 19.0 | 9.0 | 19.2 | 57.5 | 0.9943 |
| - | 30.0 | - | - | 47.4 | 65.7 | 5.6 | 0.46 | 2.7 | 81,3 | 19.1 | 43.4 | 130.2 | 0.9870 |

***Source:*** **compiled by the authors**


ISSN 2663-0176 (Print)
ISSN 2663-7731 (Online)

The functional dependence $K = f(B)$ has a minimum for different temperature drops As the relative temperature drop $\Theta$ increases, the supply voltage $U$ increases.

The optimum relative operating current $B_{opt}$ corresponding to the minimum supply voltage $U_{\min}$ for a given thermal load $Q_0$ and branch geometry of the thermocouple $l/S$ can be determined from the condition $\frac{dK}{dB} = 0$ .The formula for the optimum operating current $B_{opt}$ corresponding to the minimum supply voltage $U_{\min}$ at a given thermal load $Q_0$ can be written as follows:.

$$B_{opt} = \frac{\left(1 - 2\frac{\Delta T_{\max}}{T_0}\Theta\right)}{\left(2 - \frac{\Delta T_{\max}}{T_0}\Theta\right)}\left[1 + \sqrt{1 + \frac{\frac{\Delta T_{\max}}{T_0}\Theta(2+\Theta)\left(2 - \frac{\Delta T_{\max}}{T_0}\Theta\right)}{\left(1 - 2\frac{\Delta T_{\max}}{T_0}\Theta\right)^2}}\right] \quad (11)$$

Fig. 3 shows the relationship between the optimum relative operating current $B_{opt}$ and the relative temperature difference $\Theta$ corresponding to the current operating mode $U_{\min}$.

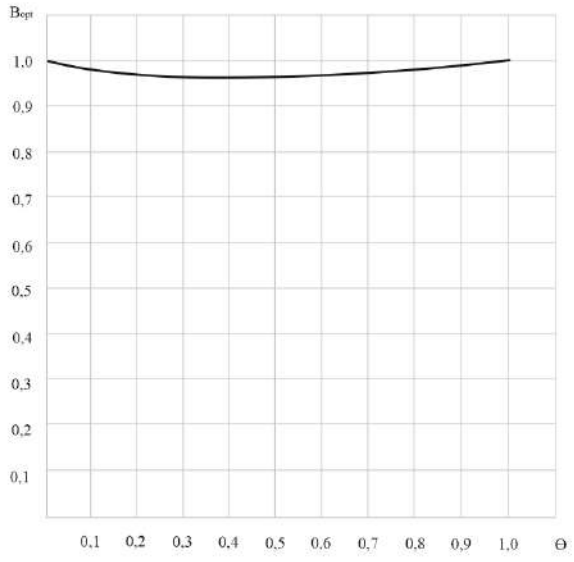



*Fig. 3.* **Dependence of optimum operating current $B_{opt}$ of a single stage TEC on the relative temperature difference $\Theta$ for current operation $\left(\frac{U}{Q_0}\right)_{\min}$ at $T = 300K, l/S = 4{,}5$**

***Source:*** **compiled by the authors**

It should be noted that the functional dependence $B_{opt} = f(\Theta)$ =0.5 has a minimum at, $B_{opt}$ =0.96.

Fig. 4 shows the dependence of the minimum supply voltage $U_{\min}$ on the thermal load value $Q_0$ for different temperature drops $\Delta T$.

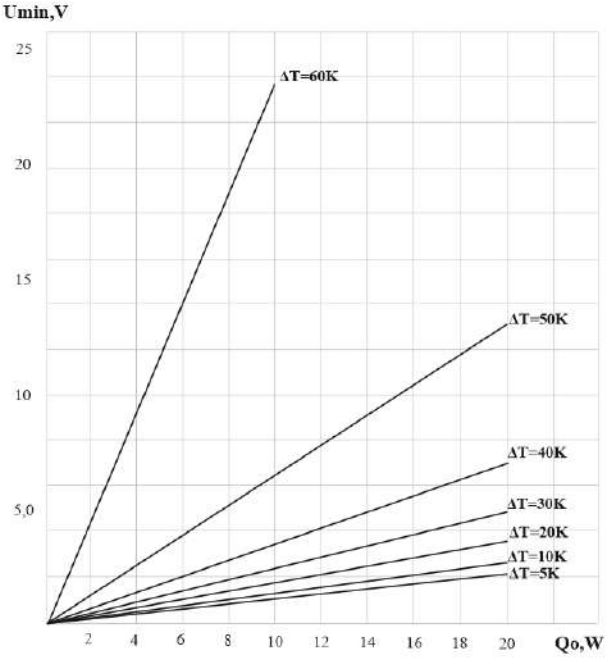



*Fig. 4.* **Dependence of the minimum supply voltage $U_{\min}$ of a group of parallel-connected TECs on the heat load $Q_0$ for different temperature differentials $\Delta T$ at $T = 300K, l/S = 4{,}5$**

***Source:*** **compiled by the authors**

As the temperature drop $\Delta T$ increases, the minimum supply voltage $U_{\min}$ increases for a given thermal load $U_{\min}$. By evaluating the value $U_{\min}$ , it is possible to select the supply voltage

$U \geq U_{\min}$ for the group of TECs in parallel electrical connection.

Using expressions (9) or (10) it is possible to determine the relative operating current $B$ for a group of TEC in parallel at a given supply voltage $U$ and a given thermal load $Q_0$, and the relative temperature drop $\Theta$ at a fixed geometry of the thermocouple branches $l/S$:

$$KB^2 - B(2K-1) + \Theta\left(K + \frac{\Delta T_{\max}}{T}\right) = 0, \quad (12)$$

where $K = \frac{UI_{\max}}{2Q_0}$.

Analysis of relation (12) shows that in the absence of a heat load $Q_0 \to 0$, $B \to \infty$, expression (12) can be written as:

$$B = 1 - \sqrt{1-\Theta}\ . \quad (13)$$

At $\Theta \to 0 \quad B \to 0$.

Thus, with a given value $K = \frac{UI_{\max}}{2Q_0}$ it is possible to determine the relative operating current $B$ for various temperature differences $\Delta T$.

Fig. 5 shows the dependence of the value $K$ on the relative operating current $B$ for different temperature differences $\Delta T$. The dotted line indicates the geometric location of the points corresponding to the minimum of $K_{\min}$.

As the temperature drop $\Delta T$ increases, the value $K$ at a given relative operating current $B$ increases.

We use a system of equations to determine the basic parameters, reliability and dynamic characteristics of the part of the complex TEC with parallel electrical connection:

$$\begin{cases} I_\Sigma = I_1 + I_2 + I_3 \\ K_1B_1^2 - B_1(2K_1-1) + \Theta_1\left(K_1 + \frac{\Delta T_{\max}}{T_0}\right) = 0 \\ K_2B_2^2 - B_2(2K_2-1) + \Theta_2\left(K_2 + \frac{\Delta T_{\max}}{T_0}\right) = 0 \\ K_3B_3^2 - B_3(2K_3-1) + \Theta_3\left(K_3 + \frac{\Delta T_{\max}}{T_0}\right) = 0 \end{cases} \quad (14)$$

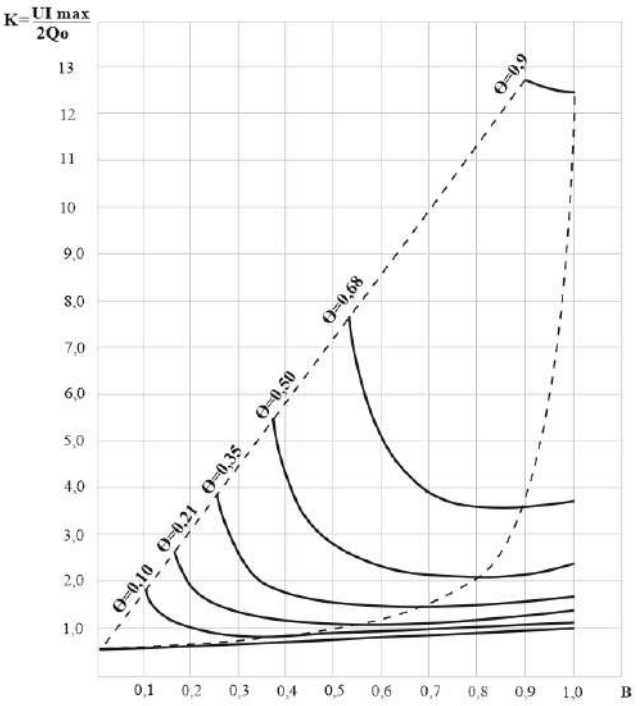



*Fig. 5.* **Dependence $K = \frac{UI_{\max}}{2Q_0}$ of single stage TEC magnitude on relative operating current $B$ for different relative temperature drops $\Theta$ at $T = 300K, l/S = 4{,}5$**

***Source:*** **compiled by the authors**

where $I_\Sigma$ is the magnitude of the operating current of the part of the TEC complex with series electrical connection, A; $I_1, I_2, I_3$ is respectively, the operating currents in the three parallel circuits, A; *; $Q_{01}, Q_{02}, Q_{03}$ is the value of thermal load of the corresponding parallel chain; $l/S$ is geometry of thermoelement branches is the same in all chains $l/S$ =4.5; $U$ is the supply voltage of the part of the TEC complex with parallel electric connection; $\Theta_1, \Theta_2, \Theta_3$ are respectively, relative temperature differences in the different circuits of the part of the TEC complex with parallel electric connection.

## ANALYSIS OF THE COMPLEX MODEL IN AN UNEVEN TEMPERATURE FIELD

Results of calculations of basic parameters, reliability indices and dynamic characteristics of a part of the complex TEC with parallel electric connection in the uneven temperature field with different thermal load $T_0$ at the fixed geometry of


ISSN 2663-0176 (Print)
ISSN 2663-7731 (Online)

thermoelement branches $l/S$ =4.5 for different supply voltages $U$, are given in Table 2.

A graphical method can be used to determine the relative operating current $B$ in each parallel circuit.

Fig. 6 shows the dependence of the supply voltage $U$ of a group of TECs in parallel with the relative operating current $B$ for different thermal loads $Q_0$ and cooling levels $T_0$ in a non-uniform temperature field.

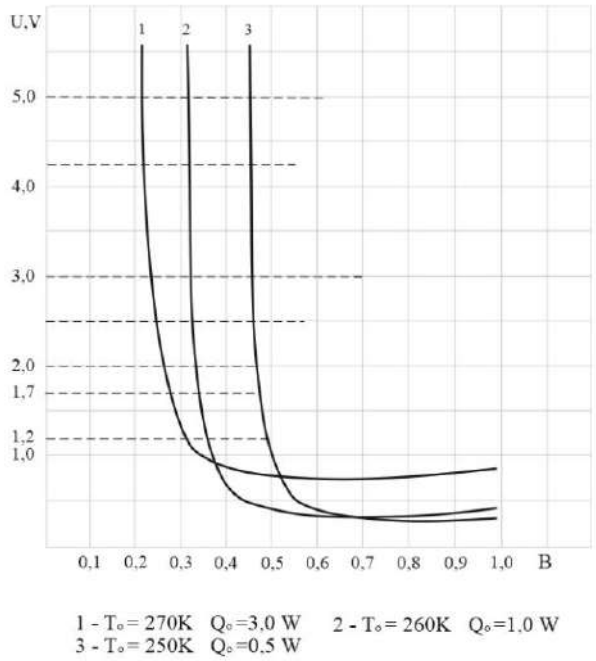



*Fig. 6.* **Dependence of the supply voltage $U$ of a group of parallel-coupled TECs on the relative operating current $B$ for different levels $T_0$ of cooling and thermal load $Q_0$ at $T = 300K, l/S = 4.5$:**

**1 – $T_0$ =270K; $Q_0$ =3.0W; 2 – $T_0$ =260K; $Q_0$ =1.0W; 3 – $T_0$ =250K; $Q_0$ =0.5W**

***Source:*** **compiled by the authors**

The functional dependence $U = f(B)$ has a minimum:

1) $U_{\min}$ =0.75V at $B_{opt}$ =0.7 for $Q_0$ =3.0W, $T_0$ =270K;

2) $U_{\min}$ =0.3V at $B_{opt}$ =087 for $Q_0$ =1.0W, $T_0$ =260K;

3) $U_{\min}$ =0.35V at $B_{opt}$ =0.9 for $Q_0$ =0.5W, $T_0$ =250K.

When selecting the supply voltage $U$ for each TEC from the group with parallel electric connection, the condition must be observed $U \geq U_{\min}$.

As the supply voltage $U$ increases for each TEC from the group with parallel electric connection for different thermal load $Q_0$ and cooling level $T_0$ in an uneven temperature field:

– the value of the operating current $I$ decreases (Fig. 7);

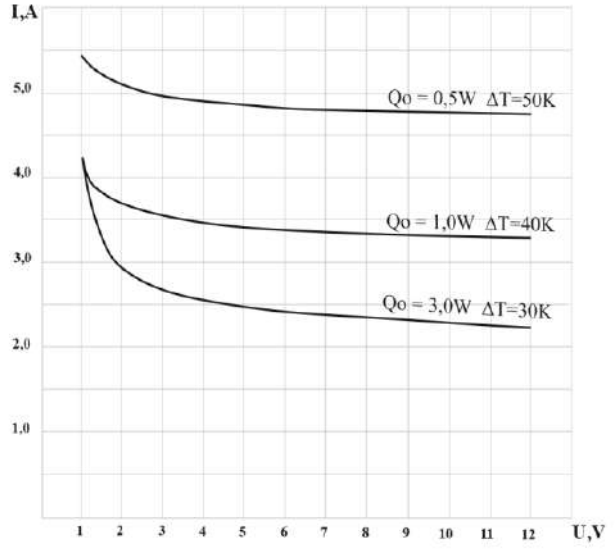



*Fig. 7.* **Dependence of the operating current $I$ of a TEC from a group with parallel electric connection on the supply voltage $U$ for different thermal loads $Q_0$ on the cooling level $T_0$ at $T = 300K, l/S = 4.5$**

***Source:*** **compiled by the authors**

– the number of thermocouples $n$ increases (Fig. 8);

– the cooling factor $E$ is reduced (Fig. 9);

– the steady-state time $\tau$ increases (Fig. 10);

– the required heat dissipation capacity $\alpha$F of the radiator is increased (Fig. 11);

– the amount of energy expended $N$ increases (Fig. 12);

– the relative failure rate $\lambda/\lambda_0$ increases (Fig. 13);

– the probability of failure-free operation $P$ decreases (Fig. 14).

For a group of TECs with parallel electric connection, we will determine the main parameters, reliability indicators and dynamic characteristics in an uneven temperature field with different thermal loads for different supply voltages. The data for the calculations are shown in Table 3.

*Table 2.* **Uneven temperature field. Parallel connection of a group of TEU complexes**

$T = 300K, l/S = 4.5$

| $Q_0$ | Θ | $B$ | l | $n$ | $W$ | $E$ | $\tau$ | $N$ | $\alpha$ F | $A$ | $T_0$ | $\lambda/\lambda_0$ | $\lambda \cdot 10^8$ | $P$ |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| $U$ =1.0V | | | | | | | | | | | | | | |
| 3.0 | 0.346 | 0.365 | 4.16 | 19.7 | 4.16 | 0.72 | 9.9 | 41 | 1.4 | 0.53 | 270 | 0.29 | 0.87 | 0.999913 |
| 1.0 | 0.50 | 0.361 | 4.05 | 19.2 | 4.05 | 0.25 | 20 | 82 | 1.0 | 0.18 | 260 | 0.30 | 0.91 | 0.999909 |
| 0.5 | 0.68 | 0.493 | 5.4 | 15.0 | 5.4 | 0.093 | 25.0 | 134 | 1.2 | 0.092 | 250 | 0.92 | 2.8 | 0.99972 |
| 4.5 | - | - | 13.6 | 53.9 | 13.6 | 0.33 | 25.0 | 257 | 3.6 | - | - | 1.51 | 4.53 | 0.99955 |
| $U$ =1.2V | | | | | | | | | | | | | | |
| 3.0 | 0.346 | 0.317 | 3.6 | 26.3 | 4.35 | 0.69 | 11.9 | 52.0 | 1.5 | 0.44 | 270 | 0.21 | 0.64 | 0.999936 |
| 1.0 | 0.50 | 0.35 | 3.9 | 23.7 | 4.7 | 0.21 | 22.0 | 103 | 1.1 | 0.15 | 260 | 0.32 | 0.96 | 0.999904 |
| 0.5 | 0.68 | 0.48 | 5.25 | 18.4 | 6.3 | 0.08 | 26.8 | 169 | 1.4 | 0.076 | 250 | 1.03 | 3.1 | 0.99969 |
| 4.5 | - | - | 12.75 | 68.4 | 15.4 | 0.29 | 26.8 | 324 | 4.0 | - | - | 1.56 | 4.7 | 0.99953 |
| $U$ =1.5V | | | | | | | | | | | | | | |
| 3.0 | 0.346 | 0.28 | 3.2 | 35.9 | 4.8 | 0.62 | 14.2 | 69 | 1.6 | 0.35 | 270 | 0.17 | 0.52 | 0.999948 |
| 1.0 | 0.50 | 0.335 | 3.8 | 30.4 | 5.7 | 0.18 | 24.4 | 138 | 1.3 | 0.12 | 260 | 0.35 | 1.05 | 0.999895 |
| 0.5 | 0.68 | 0.47 | 5.1 | 23.4 | 7.7 | 0.065 | 29.0 | 224 | 1.6 | 0.06 | 250 | 1.2 | 3.6 | 0.99964 |
| 4.5 | - | - | 12.1 | 89.7 | 18.2 | 0.25 | 29.0 | 431 | 4.5 | - | - | 1.72 | 5.2 | 0.99948 |
| $U$ =1.7V | | | | | | | | | | | | | | |
| 3.0 | 0.346 | 0.267 | 3.0 | 42.0 | 5.2 | 0.58 | 15.5 | 80 | 1.6 | 0.31 | 270 | 0.16 | 0.49 | 0.999951 |
| 1.0 | 0.50 | 0.33 | 3.7 | 34.7 | 6.3 | 0.16 | 25.6 | 160 | 1.45 | 0.105 | 260 | 0.38 | 1.12 | 0.999888 |
| 0.5 | 0.68 | 0.46 | 5.1 | 26.5 | 8.6 | 0.06 | 30.1 | 259 | 1.8 | 0.054 | 250 | 1.3 | 3.9 | 0.99961 |
| 4.5 | - | - | 11.8 | 103.2 | 20.1 | 0.22 | 30.1 | 499 | 4.9 | - | - | 1.84 | 5.52 | 0.99945 |
| $U$ =2.0V | | | | | | | | | | | | | | |
| 3.0 | 0.346 | 0.25 | 2.9 | 51.2 | 5.7 | 0.52 | 17.2 | 99.0 | 1.75 | 0.26 | 270 | 0.16 | 0.47 | 0.999953 |
| 1.0 | 0.50 | 0.32 | 3.6 | 41.2 | 7.2 | 0.14 | 27.2 | 196 | 1.6 | 0.09 | 260 | 0.41 | 1.24 | 0.999876 |
| 0.5 | 0.68 | 0.46 | 5.0 | 30.8 | 9.8 | 0.05 | 31.5 | 310 | 2.1 | 0.046 | 250 | 1.45 | 4.35 | 0.99957 |
| 4.5 | - | - | 11.5 | 123.2 | 22.7 | 0.20 | 31.5 | 605 | 5.45 | - | - | 2.0 | 6.0 | 0.99940 |
| $U$ =3.0V | | | | | | | | | | | | | | |
| 3.0 | 0.346 | 0.23 | 2.6 | 82.6 | 7.8 | 0.38 | 21.5 | 168 | 2.2 | 0.175 | 270 | 0.17 | 0.50 | 0.999950 |
| 1.0 | 0.50 | 0.31 | 3.5 | 63.3 | 10.5 | 0.095 | 31.3 | 328 | 2.3 | 0.06 | 260 | 1.05 | 3.2 | 0.99968 |
| 0.5 | 0.68 | 0.45 | 4.9 | 47.8 | 14.7 | 0.034 | 35.5 | 522 | 3.0 | 0.03 | 250 | 2.05 | 6.2 | 0.99938 |
| 4.5 | - | - | 11.0 | 193.7 | 33.0 | 0.14 | 35.5 | 1018 | 7.5 | - | - | 3.3 | 9.8 | 0.9990 |
| $U$ =6.0V | | | | | | | | | | | | | | |
| 3.0 | 0.346 | 0.21 | 2.4 | 173.8 | 14.2 | 0.21 | 28.7 | 406 | 3.4 | 0.09 | 270 | 0.24 | 0.71 | 0.999929 |
| 1.0 | 0.50 | 0.30 | 3.4 | 130 | 20.3 | 0.05 | 38.4 | 780 | 4.3 | 0.03 | 260 | 0.98 | 2.95 | 0.99970 |
| 0.5 | 0.68 | 0.44 | 4.8 | 97.4 | 29.0 | 0.017 | 42.2 | 1222 | 5.9 | 0.015 | 250 | 3.9 | 11.6 | 0.99884 |
| 4.5 | - | - | 10.6 | 401.2 | 63.5 | 0.070 | 42.2 | 2408 | 13.6 | - | - | 5.1 | 15.4 | 0.9985 |
| $U$ =9.0V | | | | | | | | | | | | | | |
| 3.0 | 0.346 | 0.20 | 2.3 | 262 | 20.3 | 0.15 | 32.9 | 669 | 4.7 | 0.06 | 270 | 0.32 | 0.96 | 0.99990 |
| 1.0 | 0.50 | 0.30 | 3.35 | 196.4 | 30.2 | 0.033 | 42.4 | 1278 | 6.2 | 0.02 | 260 | 1.4 | 4.2 | 0.99958 |
| 0.5 | 0.68 | 0.44 | 4.8 | 149.1 | 43.8 | 0.011 | 46.3 | 2028 | 8.9 | 0.01 | 250 | 5.7 | 17.2 | 0.9983 |
| 4.5 | - | - | 10.5 | 607.5 | 94.3 | 0.05 | 46.3 | 3975 | 19.8 | - | - | 7.4 | 22.3 | 0.9978 |
| $U$ =12.0V | | | | | | | | | | | | | | |
| 3.0 | 0.346 | 0.20 | 2.3 | 359.8 | 27.2 | 0.11 | 36.2 | 984 | 6.0 | 0.044 | 270 | 0.41 | 1.22 | 0.99988 |
| 1.0 | 0.50 | 0.30 | 3.3 | 246 | 37.5 | 0.027 | 44.6 | 1672 | 7.7 | 0.015 | 260 | 1.74 | 5.2 | 0.99948 |
| 0.5 | 0.68 | 0.44 | 4.78 | 180.7 | 52.9 | 0.01 | 48.0 | 2539 | 10.7 | 0.0076 | 250 | 6.9 | 20.7 | 0.9978 |
| 4.5 | - | - | 10.4 | 786.5 | 117.6 | 0.04 | 48.0 | 5195 | 24.4 | - | - | 9.0 | 27.0 | 0.9973 |

***Source:*** **compiled by the authors**


ISSN 2663-0176 (Print)
ISSN 2663-7731 (Online)

*Table 3.* **Results of calculations of main parameters and indices for group of TEC in non-uniform temperature field**

$T = 300K, l/S = 4.5$, $Q_0$ =4.5W

| No. | $U, V$ | $n$, pcs | $W$, W | $E$ | $\tau, s$ | $N$, W·s | $\alpha$ F, W/K | $I_0$, A | $\lambda/\lambda_0$ | $\lambda \cdot 10^8$ 1/h | $P$ |
|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | 1.0 | 53.9 | 13.6 | 0.33 | 25.0 | 257 | 3.6 | 13.6 | 1.51 | 4.53 | 0.99955 |
| 2 | 1.2 | 68.4 | 15.4 | 0.29 | 27.0 | 324 | 4.0 | 12.7 | 1.56 | 4.7 | 0.99953 |
| 3 | 1.5 | 89.7 | 18.2 | 0.25 | 29.0 | 431 | 4.5 | 12.1 | 1.72 | 5.2 | 0.99948 |
| 4 | 1.7 | 103.2 | 20.1 | 0.22 | 30.0 | 499 | 4.9 | 11.8 | 1.84 | 5.52 | 0.99945 |
| 5 | 2.0 | 123.2 | 22.7 | 0.20 | 32.0 | 605 | 5.45 | 11.5 | 2.0 | 6.0 | 0.99940 |
| 6 | 3.0 | 193.7 | 33.0 | 0.14 | 36.0 | 1018 | 7.5 | 11.0 | 3.3 | 98 | 0.9990 |
| 7 | 6.0 | 401 | 63.5 | 0.07 | 42.0 | 2404 | 13.6 | 10.6 | 5.1 | 15.4 | 0.9985 |
| 8 | 9.0 | 607 | 94.3 | 0.05 | 46.0 | 3975 | 19.8 | 10.5 | 7.4 | 22.3 | 0.9978 |
| 9 | 12.0 | 787 | 117.6 | 0.04 | 48.0 | 5195 | 24.4 | 10.4 | 9.0 | 27.0 | 0.9973 |

***Source:*** **compiled by the authors**

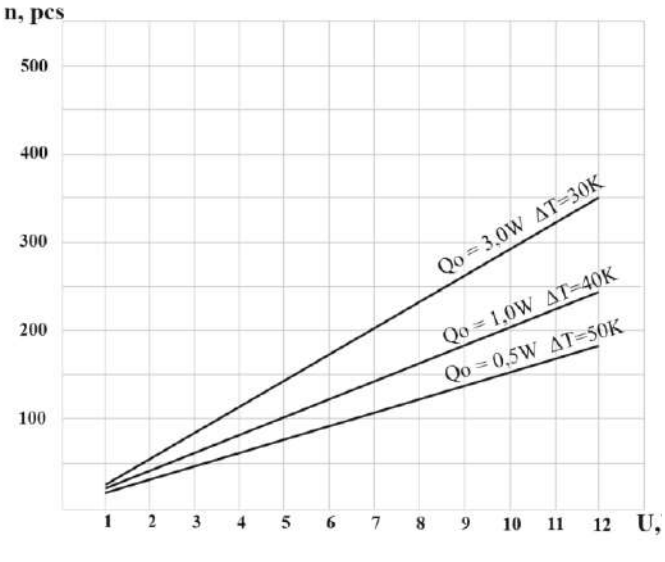



*Fig. 8.* **Dependence of number of thermocouples $n$ from the group with parallel electric connection on supply voltage $U$ for different thermal load $Q_0$ and cooling level $\Delta T$ at $T = 300K, l/S = 4.5$**

***Source:*** **compiled by the authors**

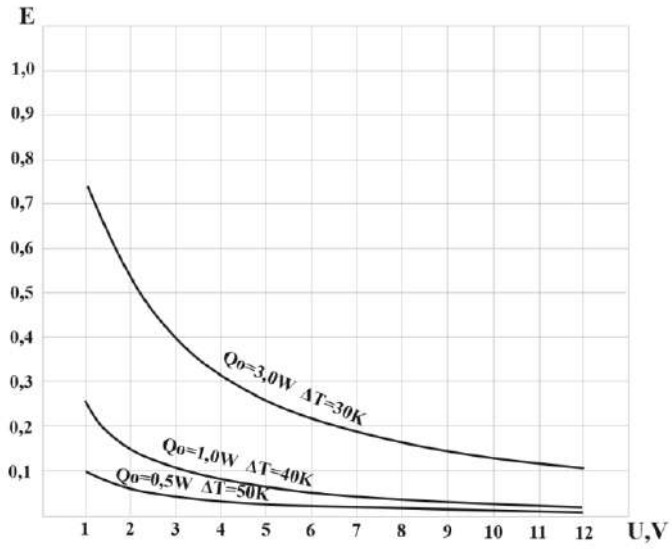



*Fig. 9.* **Dependence of the cooling factor $E$ of the TEC from the group with parallel electric connection on the supply voltage $U$ for different heat load $Q_0$ and cooling levels $T_0$ at $T = 300K, l/S = 4.5$**

***Source:*** **compiled by the authors**

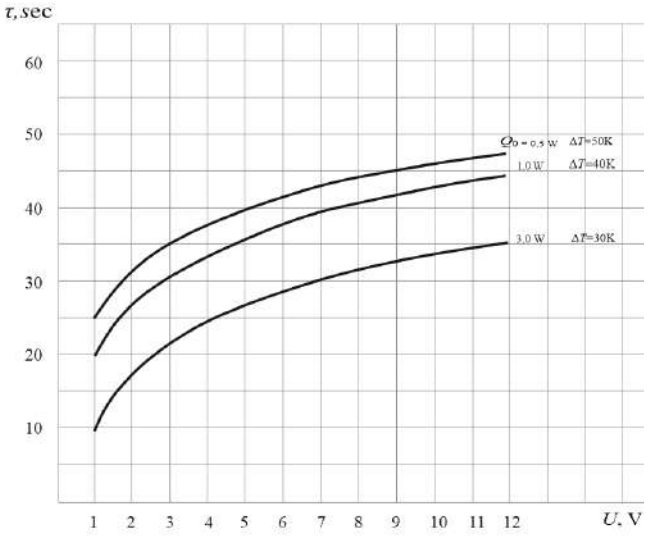



*Fig. 10.* **Dependence of time $\tau$ to steady-state operation of the TEC from the group with parallel electric connection on supply voltage $U$ for different thermal load $Q_0$ and cooling level at $T = 300K, l/S = 4.5$**

***Source:*** **compiled by the authors**

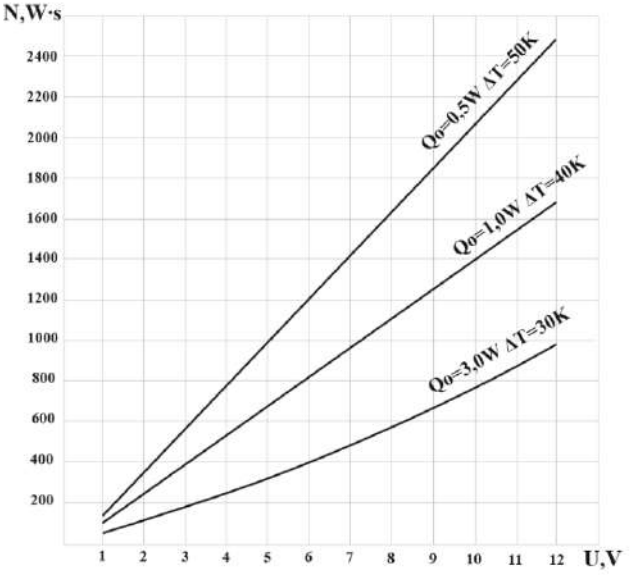



*Fig. 12.* **Dependence of the amount of energy expended $N$ by the TEC from the group with parallel electric connection on the supply voltage $U$ for different thermal load $Q_0$ and cooling level $T_0$ at $T = 300K, l/S = 4.5$**

***Source*****: compiled by the authors**

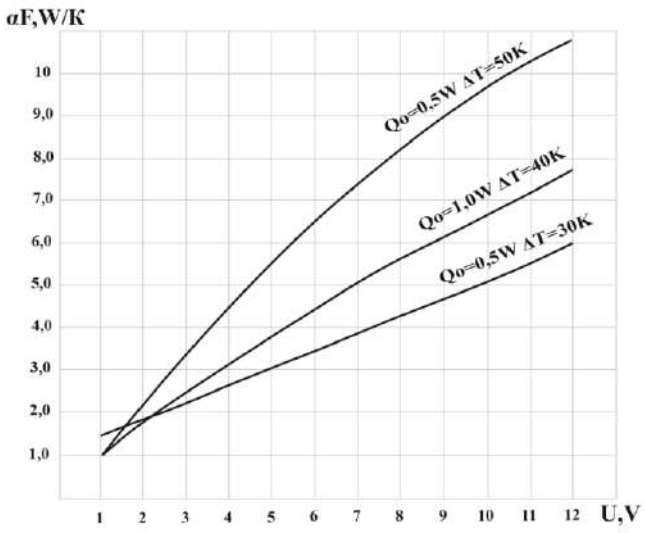



*Fig. 11***. Dependence of heat dissipation capacity $\alpha$ F of the heatsink from the group with parallel electric connection on supply voltage $U$ for different heat load $Q_0$ mi cooling level $T_0$ at $T = 300K, l/S = 4.5$**

***Source:*** **compiled by the authors**

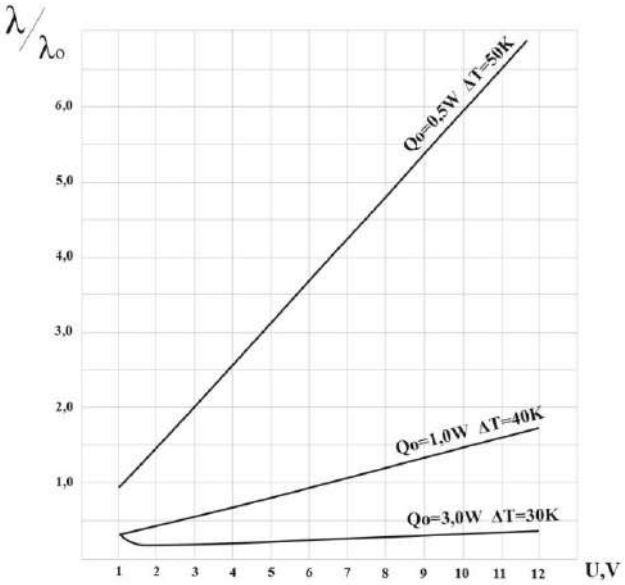



Fig. 13. **Dependence of relative failure rate $\lambda/\lambda_0$ of TECs from the group with parallel electric connection on supply voltage $U$ for different thermal load $Q_0$ and cooling level $T_0$ at $T = 300K, l/S = 4.5$**

***Source*****: compiled by the authors**


ISSN 2663-0176 (Print)
ISSN 2663-7731 (Online)

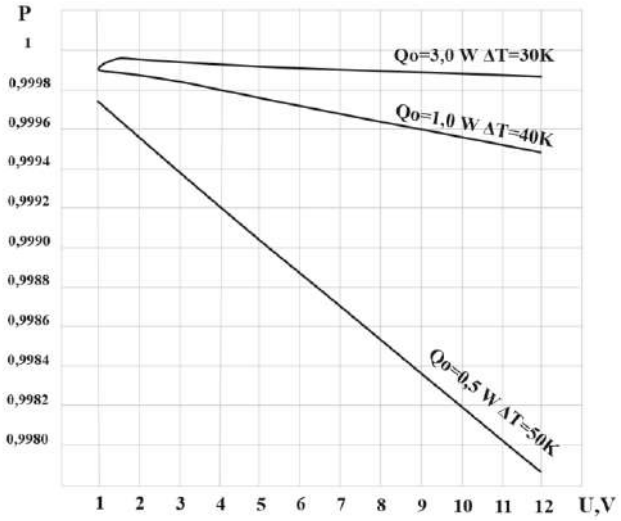



*Fig. 14*. **Relation of the probability of no-failure operation $P$ of the TEC from the group with parallel electric connection to the supply voltage $U$ for different thermal load $Q_0$ and cooling level $T_0$ at $T = 300K, l/S = 4.5$**

***Source:*** **compiled by the authors**

As the supply voltage $U$ increases for a group of TECs with parallel electric connection in an uneven temperature field with total heat load $Q_0$ =4.5W and thermocouple branch geometry $l/S$ =4.5:

– the cooling coefficient $E$ decreases (Fig. 15, item 1);

– the number of thermoelements $n$ increases (Fig. 15, item 2);

– steady-state operation time $\tau$ increases (Fig. 15, item 3);

– the operating current $I$ decreases (Fig. 16, item 1);

– the required heat dissipation capability $\alpha F$ of the heat sink increases (Fig. 16, item 2)

– the amount of energy expended $N$ increases (Fig. 16, item 3);

– the relative failure rate $\lambda/\lambda_0$ increases (Fig. 17, item 1);

– the probability of no-failure operation $P$ decreases (Fig.17, item 2).

The results of calculations of the main parameters, reliability indicators and dynamic characteristics of the complex with mixed electrical connection of TEC (three connected in series and three in parallel) in an uneven temperature field are given in Table 4.

As the supply voltage $U$ of a group of TECs with parallel electric connection of a TEC complex with a total heat load $Q_0$ =34.5W and thermocouple branch geometry $l/S$ =4.5 in an irregular temperature field increases:

– the cooling coefficient $E$ decreases (Fig. 18, item 1);

– the number of thermocouples $n$ increases (Fig. 18, item 2)

– time to reach steady-state operation $\tau$ increases (Fig. 18, item 3);

*Table 4.* **Mixed electrical connection of the TEC complex.**
**$T$ =300K; $l/S$ =4.5; $T - T_c$ =5K; $Q_0$ =34.5W**

| No. | $U_=, V$ | $W$, $W$ | $E$ | $U_\Sigma, V$ | $n$, $pcs$ | $\tau_\Sigma, s$ | $\alpha F_\Sigma$, W/K | $N_\Sigma$, $W{\cdot}s$ | $\lambda/\lambda_{0\Sigma}$ | $\lambda{\cdot}10^8$ 1/h | $P_\Sigma$ |
|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | 1.0 | 79.3 | 0.435 | 6.6 | 101.3 | 25.0 | 22.7 | 338 | 44.9 | 134.7 | 0.98662 |
| 2 | 1.2 | 81.1 | 0.425 | 6.8 | 115.8 | 26.8 | 23.1 | 405 | 45.0 | 135 | 0.98659 |
| 3 | 1.5 | 83.9 | 0.411 | 7.1 | 137.1 | 29.0 | 23.6 | 512 | 45.12 | 135.4 | 0.98655 |
| 4 | 1.7 | 85.8 | 0.402 | 7.3 | 150.6 | 30.0 | 24.0 | 580 | 45.2 | 135.7 | 0.98652 |
| 5 | 2.0 | 88.4 | 0.39 | 7.6 | 170.6 | 31.5 | 24.6 | 686 | 45.4 | 136.2 | 0.98647 |
| 6 | 3.0 | 98.7 | 0.35 | 8.6 | 241.1 | 36.0 | 26.7 | 1100 | 46.7 | 140.5 | 0.9861 |
| 7 | 6.0 | 129.2 | 0. 267 | 11.6 | 449 | 42.0 | 32.7 | 2490 | 48.5 | 145.5 | 0.98555 |
| 8 | 9.0 | 160.0 | 0.216 | 14.6 | 655 | 46.0 | 38.9 | 4056 | 50.8 | 152.4 | 0.9849 |
| 9 | 12.0 | 183.3 | 0.19 | 17.6 | 834 | 48.0 | 43.5 | 5276 | 52.4 | 157.2 | 0.9844 |

***Source:*** **compiled by the authors**

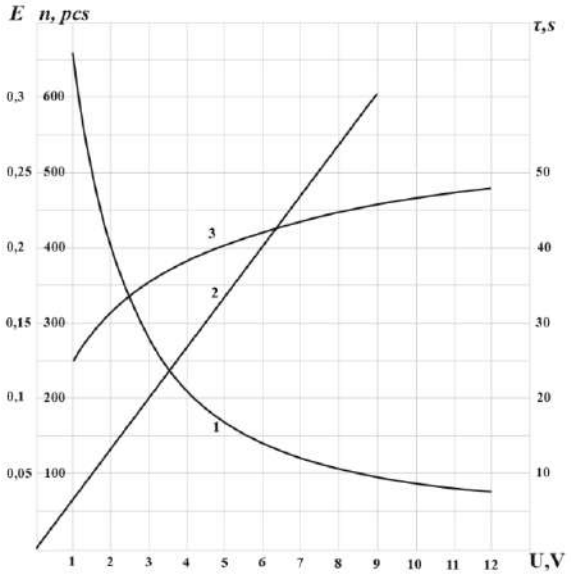



*Fig. 15.* **Dependence of refrigerating factor $E$, ramp-up time $\tau$, number of thermocouples $n$ in the group of TECs with parallel electric connection on supply voltage $U$ at $T = 300K, l/S = 4.5$, $Q_0$ =4.5W**

**$1 - E = f(U), 2 - n = f(U), 3 - \tau = f(U)$**

***Source*: compiled by the authors**

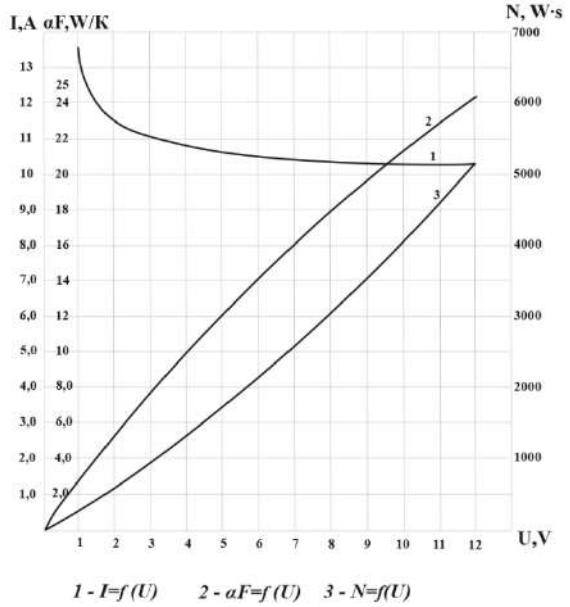



*Fig. 16.* **Dependence of operating current $I$, heat dissipation capacity $\alpha F$ of the heatsink and amount of energy expended $N$ by the TEC group with parallel electric connection as a function of supply voltage $U$ at $T = 300K, l/S = 4.5$, $Q_0$ =4.5W**

***Source*: compiled by the authors**

– increases energy $N$ consumption (Fig. 19, item 1);

– the required heat dissipation capacity of the heat sink $\alpha F$ increases (Fig. 19, item 2);

– the relative failure rate $\lambda/\lambda_0$ increases (Fig. 20, item 1);

– the probability of failure-free operation $P$ decreases (Fig. 20, item 2).

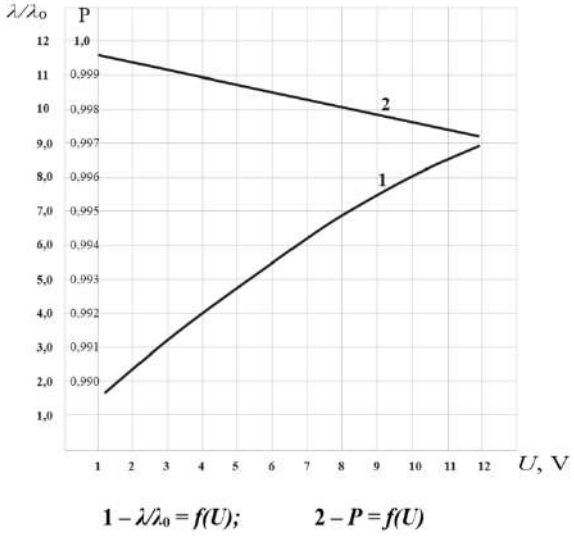



*Fig. 17.* **Dependence of the relative failure rate $\lambda/\lambda_0$ and the probability $P$ of no-failure operation for the parallel electric connection on the supply voltage $U$ at $T = 300K, l/S = 4.5$; =4.5W; $\lambda_0 = 3 \cdot 10^{-8}\, 1/h$; $t = 10^4 h$**

***Source*: compiled by the authors**

## CONCLUSIONS

A thermophysical model of thermal mode support system has been developed on the basis of the complex of thermoelectric elements with mixed electrical connection to control the thermal mode of a number of heat-dependent elements of radio-electronic equipment in an uneven temperature field with different load $Q_0$ at geometry of thermoelement branches $l/S$ =4.5.

The relations for determining the relative operating current $B$ depending on supply voltage $U$, temperature differential $\Delta T$, heat load $Q_0$ for a group of TECs with parallel electric connection in an uneven temperature field at fixed geometry of thermocouple branches $l/S$ =4.5 are obtained.


ISSN 2663-0176 (Print)
ISSN 2663-7731 (Online)

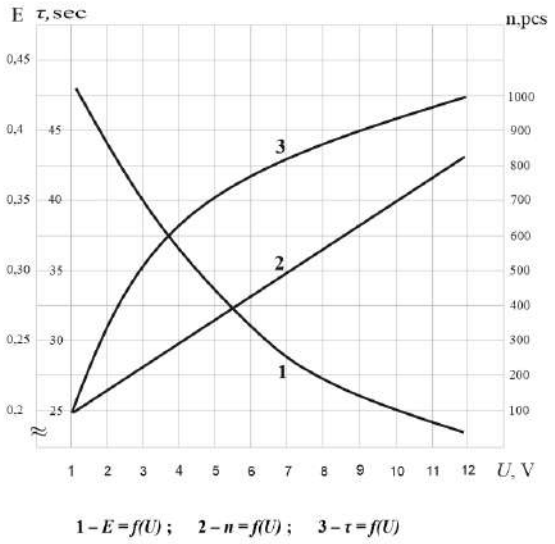



*Fig. 18.* **Dependence of refrigerating factor $E$, number of thermocouples $n$, time to reach steady-state mode of the TEC complex with mixed electrical connection on the supply voltage $U$ of the TEC group with parallel electrical connection in an uneven temperature field at $T = 300K, l/S = 4.5,\ Q_0$ =34.5W.**

$1-E=f(U), 2-n=f(U), 3-\tau=f(U)$

***Source*: compiled by the authors**

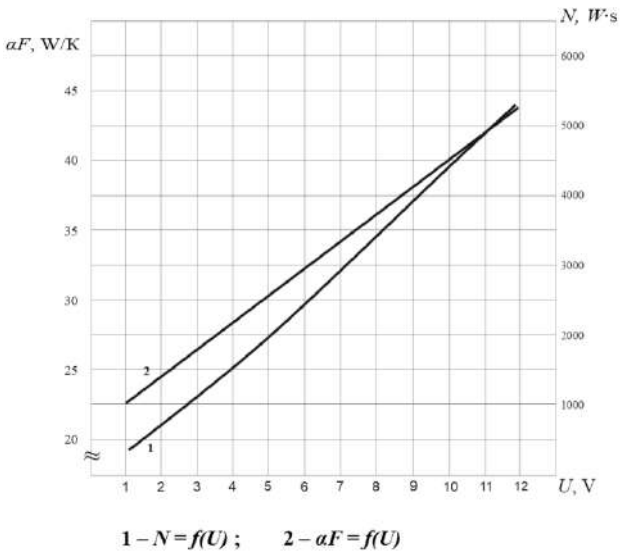



*Fig. 19.* **Dependence of the amount of energy input $N$, required heat dissipation capacity of the heat sink $\alpha F$ of the mixed electrical connection TEC complex on the supply voltage $U$ of the TEC group with parallel electrical connection in an uneven temperature field at $T = 300K, l/S = 4.5,\ Q_0$ =34.5W.**

$1-N=f(U), 2-\alpha F=f(U)$

***Source*: compiled by the authors**

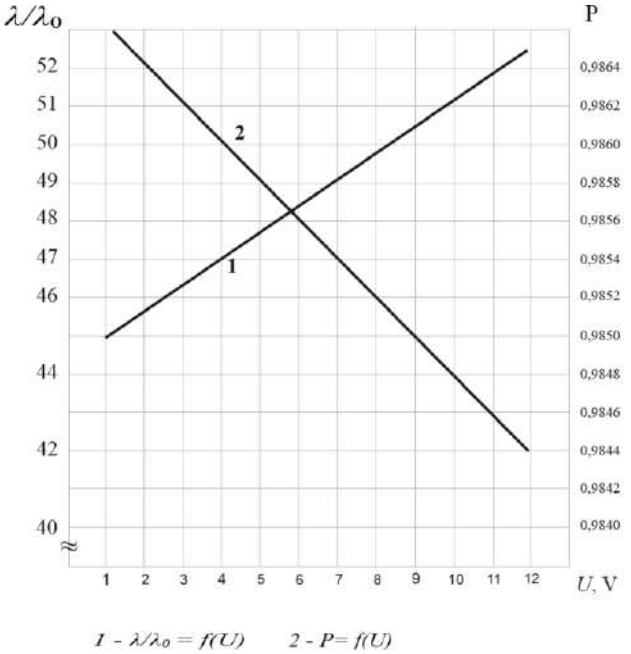



*Fig. 20.* **Dependence of the relative failure rate $\lambda/\lambda_0$ and the probability $P$ of no-failure operation of a mixed electrical coupled TEC complex on the supply voltage $U$ of a group of TECs with parallel electrical coupling in a non-uniform temperature field at $T = 300K, l/S = 4.5,\ Q_0$ =4.5W, $\lambda_0 = 3\cdot 10^{-8}\,1/h,\ t = 10^4 h$**

**Source: compiled by the authors**

A comparative analysis of the main parameters, reliability indices and dynamic characteristics of a complex of fuel injection equipment with mixed electrical connection in an uneven temperature field depending on the supply voltage of a group of fuel injection equipment with parallel electrical connection has been carried out.

Analysis of the research results showed the possibility of selecting the optimum supply voltage for the group of fuel injection equipment with parallel electric connection in the relationship of energy, mass-dimensional and dynamic characteristics, taking into account the reliability indicators of the complex as a whole.

It should be noted that as the supply voltage $U$ decreases, the power, mass-dimensional and dynamic characteristics of a group of TEC with parallel electrical connection improve, and the reliability of a complex with mixed electrical connection in an uneven temperature field increases.

## REFERENCES

1. Gordon, N. E. “Thermal computations for electronics, conductive, radiative and convective air cooling”. *CRC Press. Boca Raton*. 2020. 404 p. ISBN 9781003029328. DOI: https://doi.org/10.1201/9781003029328.

2. Sulaiman, A. C., Amin, N. A. M., Basha, M. H., Majid, M. S. A., Nasir, N. F. b. M. & Zaman, I. “Cooling performance of thermoelectric cooling (TEC) and applications: A Review. *MATEC” Web Conf.* 2018; Vol. 225: 03021. DOI: https://doi.org/10.1051/matecconf/201822503021.

3. Venkatesan, K. & Venkataramanan, M. “Experimental and simulation studies on thermoelectric cooler: A performance study approach”. *International Journal of Thermophysics*; 2020; 41. DOI: https://doi.org/10.1007/s10765-020-2613-2.

4. Wang, L. Q., Zhou, L. & Fan, H. T. “Design of cooling system for infrared CCD camera used to monitor burden surface of blast furnace based on thermoelectric coolers”. *Applied Mechanics and Materials*. 2013; 419: 778–783. DOI: https://doi.org/10.4028/www.scientific.net/AMM.419.778.

5. Yu, J., Zhu, Q., Kong, L., Wang, H. & Zhu, H. “Modeling of an integrated thermoelectric generation–cooling system for thermoelectric cooler waste heat recovery”. *College of Aerospace and Civil Engineering, Harbin Engineering University, Harbin 150001, China. Energies.* 2020; 13 (18): 4691. DOI: https://doi.org/10.3390/en13184691.

6. Manikandan, S., Kaushik, S.C. & Yang, R. “Modified pulse operation of thermoelectric coolers for building cooling applications”. *Energy Conversion and Management*. 2017; 140: 145–156. DOI: https://doi.org/10.1016/j.enconman.2017.03.003.

7. Dong, X. & Liu, X. “Multi-objective optimal design of microchannel cooling heat sink using topology optimization method”. *Numerical Heat Transfer, Part A: Applications.* 2020; 77 (1): 90–104. DOI: https://doi.org/10.1080/10407782.2019.1682872.

8. Ebale, L. O., Pierre Gomat, L. J., Nzonzolo, L., Mavoungou, M. R. & Kibongani, F. “Optimization of a thermoelectric cooling system with peltier effect”. *Am. J. Energ. Eng.* 2019; 7 (3): 55–63. DOI: https://doi.org/10.11648/j.sjee.20190703.12.

9. Erturun, U., Mossi, K. & “A Feasibility investigation on improving structural integrity of thermoelectric modules with varying geometry”. 2012. p. 939-945 DOI: https://doi.org/10.1115/SMASIS2012 –8247.

10. Cai, Y., Wang, Y., Liu, D. & Zhao, F.-Y. “Thermoelectric cooling technology applied in the field of electronic devices: updated review on the parametric investigations and model developments”. *Appl. Therm. Eng.* 2019; 148: 238–255. DOI: https://doi.org/10.1016/j.applthermaleng.2018.11.014.

11. Irshad, K., Almalawi, A., Khan, A. I., Alam, M. M., Zahir, M. H. & Ali, A. “An IoT-Based thermoelectric air management framework for smart building applications: a case study for tropical climate”. *Sustainability.* 2020; 12(4): 1–18. DOI: https://doi.org/10.3390/su12041564.

12. Ngo, T.-T., Wang, C.-C., Chen, Y.-T. & Than, V.-T. “Developing a thermoelectric cooling module for control temperature and thermal displacement of small built-in spindle”. *Therm. Sci. Eng. Prog.* 2021; 25: 100958. DOI: https://doi.org/ 10.1016/j.tsep.2021.100958.

13. Choi, H. S., Seo, W. S. & Choi, D. K. “Prediction of reliability on thermoelectric module through accelerated life test and physics–of–failure”. *Electron. Mater. Lett.* 2011; 7. DOI: https://doi.org/10.1007/s13391–011–0917–x.

14. Song, H., Song, K. & Gao, C. “Temperature and thermal stress around an elliptic functional defect in a thermoelectric material”. *Mechanics of Materials*. 2019; 130: 58–64. DOI: https://doi.org/10.1016/ j.mechmat.2019.01.008.

15. Karri, N.K. & Mo, C. “Structural reliability evaluation of thermoelectric generator modules: influence of end conditions, leg geometry, metallization, and processing temperatures”. *Journal of Electronic Materials.* 2018; 47 (10): 6101–6120. DOI: https://doi.org/10.1007/s11664-018-6505-1.

16. Kim, H. S., Wan g, T., Liu, W., & Ren, Z. “Engineering thermal conductivity for balancing between reliability and performance of bulk thermoelectric generators”. *Advanced Functional Materials*. 2016; 26: 3678–3686. DOI: https://doi.org/10.1002/adfm.201600128.

17. Zaykov, V., Mescheryakov, V. & Zhuravlov, Yu. “Studying the influence of the thermoelectric materials parameters on the dynamics of singlecascade cooling devices”. *Eastern-European Journal of Enterprise Technology*”. https://www.scopus.com/authid/detail.uri?authorId=57192640885. 2020; 8 (103): 6–18. DOI: https://doi.org/10.15587/1729-4061.2020.195730.

18. Zaykov, V., Mescheryakov, V. & Zhuravlov, Yu. “Designing a singlecascade thermoelectric cooler with the predefined time to enter a stationary mode of operation”. *Eastern-European Journal of Enterprise Technologies*. https://www.scopus.com/authid/detail.uri?authorId=57192640885. 2019; 102: 38–46. DOI: https://doi.org/10.15587/1729-4061.2019.184400.

19. Zaykov, V.P., Kinshova, L. A. & Moiseev, V. F. “Prediction of reliability indicators, thermoelectric cooling devices. Book 1. One–stage devices”. *Publ. Polytehperiodika,* Odessa: Ukraine. 2009. 120 p.

20. Zaykov, V., Mescheryakov, V. & Zhuravlov, Y. “Analysis of relationship between the dynamics of a thermoelectric cooler and its design and modes of operation”. *Eastern-European Journal of Enterprise Technologies.* https://www.scopus.com/authid/detail.uri?authorId=57192640885. 2018; 8 (91): 12–24. DOI: https://doi.org/10.15587/1729-4061.2018.123891.

**Conflicts of Interest:** the authors declare no conflict of interest

Received 10.10.2022
Received after revision 12.11.2022
Accepted 22.11.2022

**DOI: https://doi.org/10.15276/hait.05.2022.23**
**УДК 004.662.99·519.6**

# Управління комплексом термоелектричних охолоджуючих пристроїв зі змішаним електричним з’єднанням у нерівномірному температурному полі

**Зайков Володимир Петрович** [1)]
ORCID: http://orcid.org/0000-0002-4078-3519; gradan@i.ua. Scopus Author ID: 57192640250
**Мещеряков Володимир Іванович** [2)]
ORCID: http://orcid.org/0000–0003–0499–827X; gradan@ua.fm. Scopus Author ID: 57192640885
**Журавльов Юрій Іванович** [3)]
ORCID: http://orcid.org/0000-0001-7342-1031; ivanovich1zh@gmail.com. Scopus Author ID: 57190425471
[1)] Науково-дослідницький інститут ШТОРМ, вул. Терешкової 27. Одеса, 65076, Україна
[2)] Одеський державний екологічний університет, вул. Львівська, 15. Одеса, 65026, Україна
[3)] Національний університет «Одеська морська академія», вул. Дідріхсона, 8. Одеса, 65029, Україна

## АНОТАЦІЯ

Розглянуто можливість оптимального управління тепловим режимом ряду термозалежних і теплонавантажених елементів радіоелектронної апаратури з різною потужністю розсіяння у нерівномірному температурному полі з використанням комплексу термоелектричних охолоджуючих пристроїв зі змішаним електричним з’єднанням і фіксованою геометрією гілок термоелементів. Одержані співвідношення для визначення відносного робочого струму, який відповідає мінімальному значенню напруги живлення при заданому тепловому навантаженні для різних перепадів температур і геометрії гілок термоелементів. Показано можливість вибору напруги живлення для групи термоелектричних охолоджувачів з паралельним електричним з’єднанням з використанням як аналітичного так і графічного методу вирішення системи алгебраїчних рівнянь першого і другого порядку. Приведена оцінка основних параметрів, показників надійності і динамічних характеристик комплексу термоелектричних охолоджувачів з послідовним електричним з’єднанням в режимі максимальної холодопродуктивності і варіацією напруги живлення групи охолоджувачів з паралельним електричним з’єднанням. Аналіз результатів дослідження показав можливість вибору оптимальної напруги живлення групи термоелектричних охолоджувачів з паралельним електричним з’єднанням у взаємозв’язку енергетичних, масогабаритних в динамічних характеристик з врахуванням показників надійності комплексу в цілому. Показано, що зі зменшенням напруги живлення групи з паралельним електричним з’єднанням, які входять в комплекс, покращуються енергетичні, масогабаритні і динамічні характеристики, підвищуються показники надійності комплексу зі змішаним електричним з’єднанням у нерівномірному температурному полі .

**Ключові слова:** термоелектричний охолоджувач; тепловий режим; моделі з'єднання; напруга живлення; показники надійності; динамічні характеристики

## ABOUT THE AUTHORS



**Vladimir P. Zaykov** - PhD in Engineering Sciences, Head of Sector. Research Institute "STORM". 27, Tereshkova Str. Odessa, 65076, Ukraine
ORCID: http://orcid.org/0000-0002-4078-3519; gradan@i.ua. Scopus Author ID: 57192640250.
***Research field*:** Reliability and dynamic descriptions of thermo-electric cooling devices; design, planning of the systems of providing of the thermal modes of electronic apparatus

**Зайков Володимир Петрович** - кандидат технічних наук, начальник сектору науково-дослідного інституту «ШТОРМ», вул. Терешкової 27. Одеса, 65076, Україна



**Vladimir I. Mescheryakov** - Doctor of Engineering Sciences, Professor, Head of Department of Informatics. State Environmental University, 15, Lvivska Str. Odessa, 65026, Ukraine.
ORCID: http://orcid.org/0000-0003-0499-827X; gradan@ua.fm. Scopus Author ID: 57192640885
***Research field*:** Reliability and dynamic descriptions of thermo-electric cooling devices; design of power processes; biotechnical informative systems

**Мещеряков Володимир Іванович** - доктор технічних наук, зав. кафедри Інформатики. Одеський державний екологічний університет, вул. Львівська, 15. Одеса, 65026, Україна



**Yurii I. Zhuravlov** - PhD in Engineering Sciences, Associate Professor of Department of Technology of Materials and Ship Repair. National University "Odessa Maritime Academy", 8, Didrikhson Str. Odessa, 65029, Ukraine
ORCID: http://orcid.org/0000-0001-7342-1031; ivanovich1zh@gmail.com. Scopus Author ID: 57190425471
***Research field*:** Reliability and dynamic descriptions of thermo-electric cooling devices; reliability and reparability of ship equipment

**Журавльов Юрій Іванович** - кандидат технічних наук, доцент кафедри Технології матеріалів і судноремонту. Національний університет "Одеська морська академія", вул. Дідріхсона, 8. Одеса, 65029, Україна


ISSN 2663-0176 (Print)
ISSN 2663-7731 (Online)